KEYBOARD PLAN NOTES

1. Noted devices shall be wired to unswitched side or nearest circuit.
2. Noted circuits shall be wired through pool lighting contactor located in room 136.
3. Electrical contractor shall locate lights around ductwork and piping.
4. Electrical contractor shall remove existing noted device. Remove conduit and wire to the nearest splice point.
5. Provide new switches as shown on drawings. Reconnect to the existing circuit.
6. Electrical contractor shall rewire existing lights as shown on the drawings.
7. Relocate existing device as shown. Reconnect to existing circuit.
8. Connect noted fixtures to existing exterior time clock system.

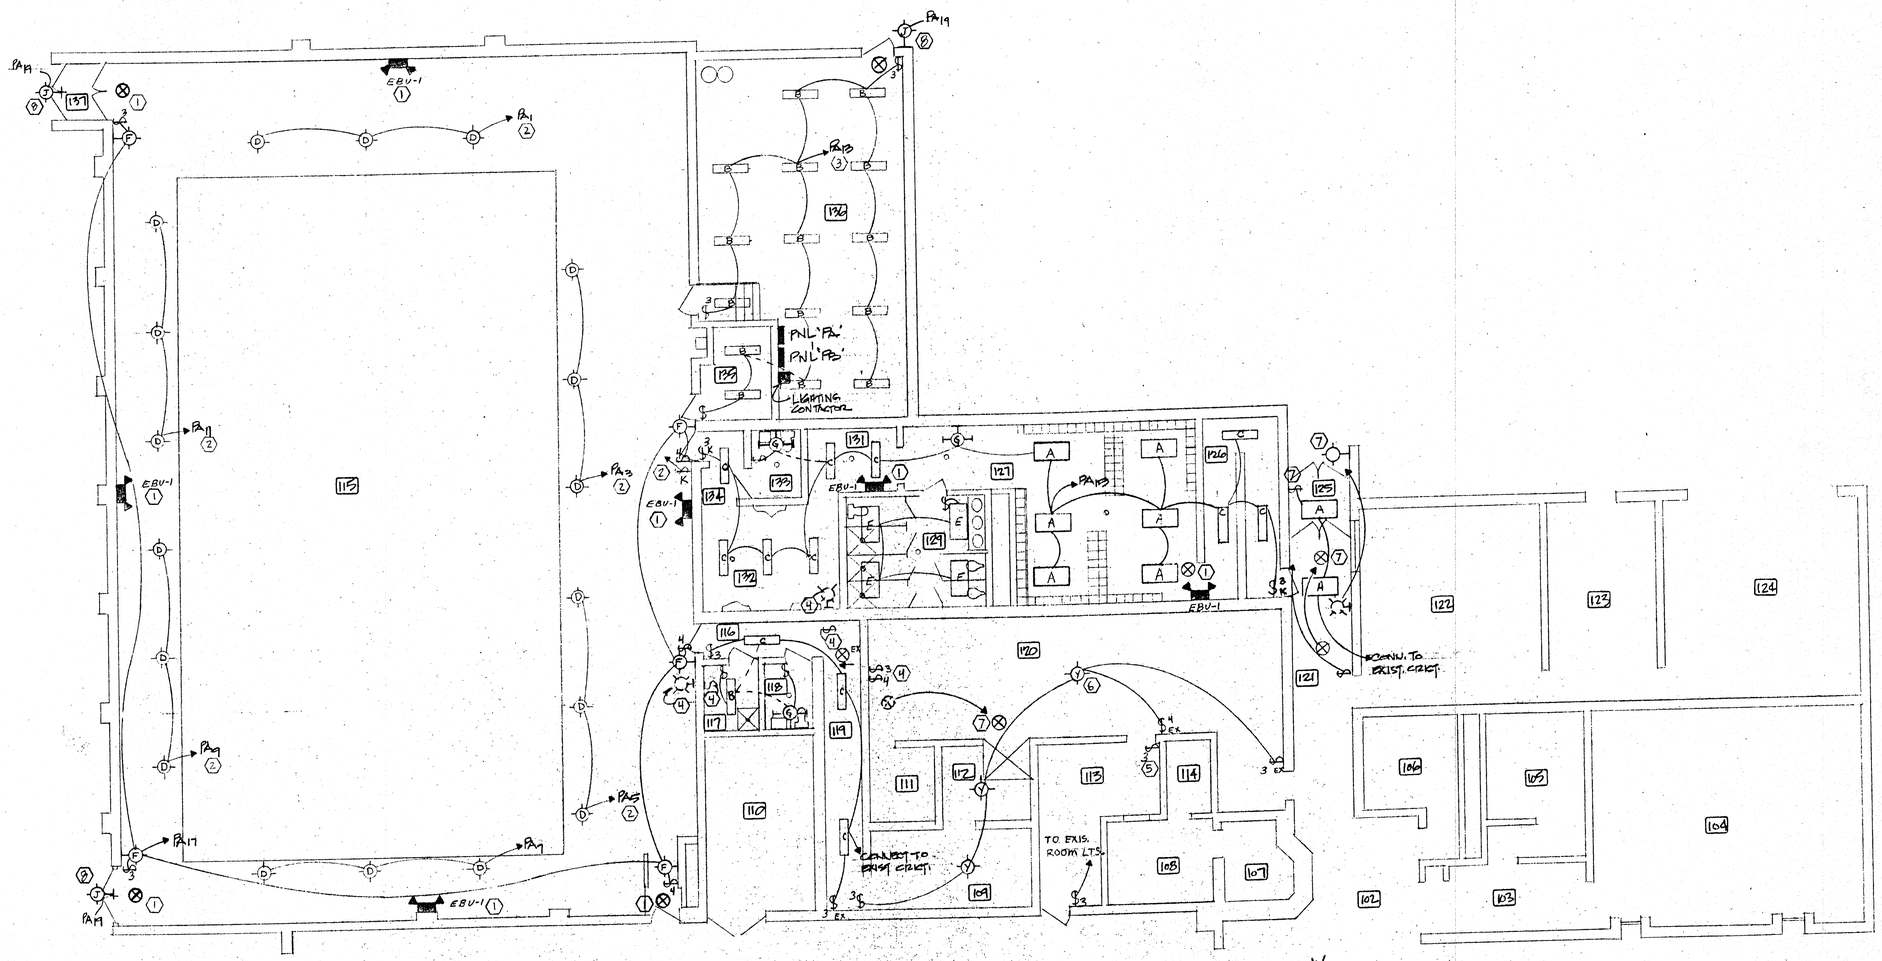

LIGHTING FLOOR PLAN

Scale: 1/8"-1'-0"



CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS AT THE SITE

KENNETH FRANK SIKORA E-16046 Green Bay, Wis. WISCONSIN REGISTERED PROFESSIONAL ENGINEER

SIKORA ENGINEERING.
MECHANICAL/ELECTRICAL
978 LAKEVIEW
GREEN BAY, WISCONSIN 54313
1-414-434-0240

SEABORG ASSOCIATES
ARCHITECTS
2012 10th St. Menominee, Mi. 49858 - Ph.(906) 863-2694

SWIMMING POOL ADDITION
UNIVERSITY / YMCA CENTER
UW - MARINETTE COUNTY
MARINETTE, WISCONSIN

DR.	CK.
KFS	KFS

DATE

JOB NO.

SHEETS

SHEET NO. E-1